

Rollator test scientifically proves Softech™ as the best mattress topper

Procedure: ASTM F 1566 – Rollator Test
Mated with Semi-Flex Foundation
100,000-Cycle Evaluation


ILD Data
8" Disk Platen – 1.5" Deflection
Sum 1/2" Increments
Topper Only After 1-Hour Recovery

Sample Construction: Single-Sided Euro Top Mattress

Panel Minimum Fill
Topper Test Sample
Inner Border Scrim
Insulator 2 oz. Synthetic Fiber Pad
Spring 357 5" VertiCoil®
Insulator 2 oz. Synthetic Fiber Pad
BTM Cover Non-Skid

Mattress Toppers Evaluated:

Latex 2.5" 24 IFD Talalux Latex
Visco 2.5" 4010 Visco Foam
Poly 2.5" 1.2-30 Polyurethane Foam
Softech™ 1102 (1353) 17 ga. 2.4" Softech

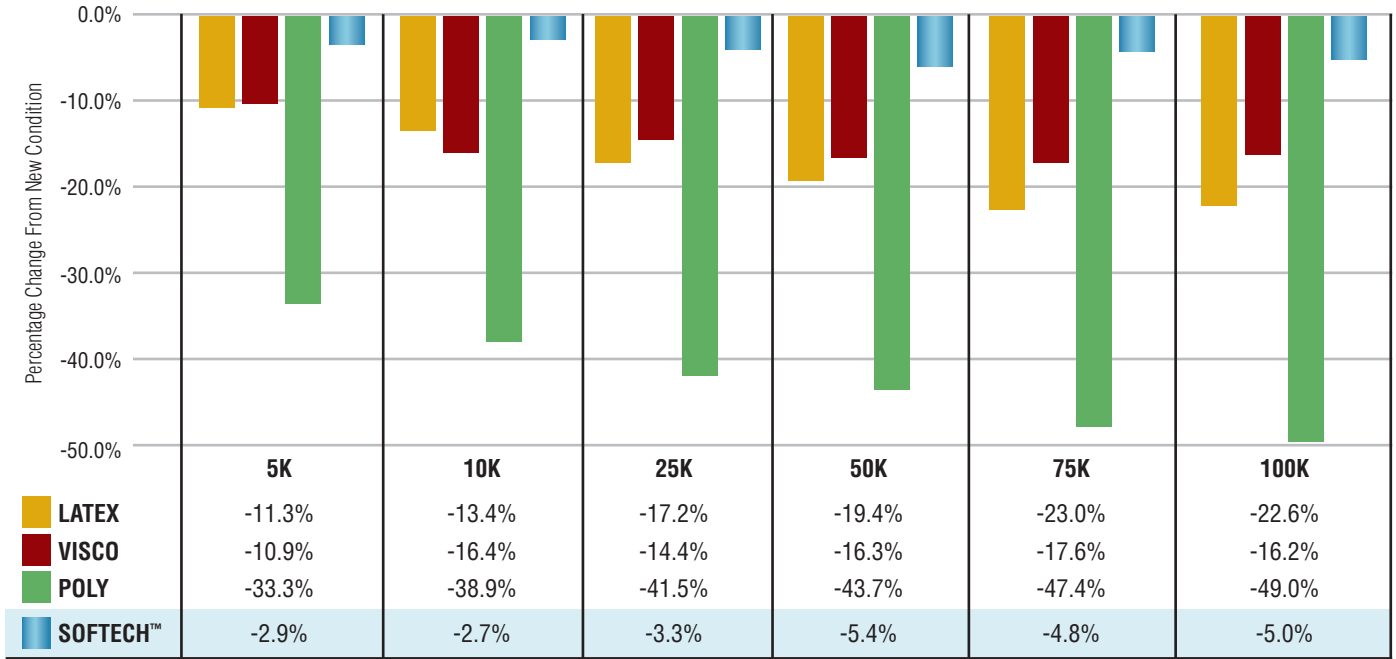

Note: Average of 5 samples.

Rollator Cycles



Leggett & Platt
INCORPORATED

address | P.O. Box 757
Carthage, MO 64836
phone | 417.358.8131

web address | www.BeddingComponents.com



Made
from
recycled
steel